



976 McIntire Ave. Zanesville, Ohio 43701 Phone: 740-704-1879 Email: [kylebaldwin@roxsol.com](mailto:kylebaldwin@roxsol.com)

**May 30, 2025**

CountryTyme Realty  
c/o Donovan Kuhn  
3451 Cincinnati-Zanesville Rd. SW.  
Lancaster, OH. 43130  
(614) 345-5317

**RE: Site and soil evaluation (Par#240007220000, Dutch Ridge Rd.)**

You requested this site and soil evaluation for your proposed lot splits. The soil logs and site plan are attached. A layout plan will also be required prior to applying for a permit to install. The information provided in this report is necessary to complete the layout plan.

Test Holes were flagged during the site visit and are in an area proposed to serve as a primary and/or secondary leaching site. Disturbance of the proposed leach areas, prior to septic system installation, may negate the validity of this report. This includes, but is not limited to, vehicle traffic, excavations, stump removal, topsoil/earth fill storage or adding permanent structures that will have an adverse impact to natural soil structure and biology. **All surface and groundwater should be diverted away from the leach field.**

Septic tank absorption fields are areas in which effluent from a septic tank is distributed into the soil through subsurface tiles or perforated pipes. Only that part of the soil between depths of 0 and 60 inches is evaluated. The ratings are based on the soil properties that affect absorption of the effluent, construction and maintenance of the system, and public health. Saturated hydraulic conductivity (Ksat), depth to a water table, ponding, depth to bedrock, and flooding affect absorption of the effluent. Stones, boulders, and bedrock interfere with installation. Subsidence interferes with installation and maintenance. Excessive slope may cause lateral seepage and surfacing of the effluent in downslope areas. Some soils are underlain by loose sand and gravel or fractured bedrock at a depth of less than 4 feet below the distribution lines. In these soils the absorption field may not adequately filter the effluent, particularly when the system is new. As a result, the ground water may become contaminated.

Rating class terms indicate the extent to which the soils are limited by all the soil features that affect the specified use (Septic Tank Absorption Field). "Not limited" indicates that the soil has features that are very favorable for the specified use. Good performance and very low maintenance can be expected. "Somewhat limited" indicates that the soil has features that are moderately favorable for the specified use. The limitations can be overcome or minimized by special planning, design, or installation. Fair performance and moderate maintenance can be expected. "Very limited" indicates that the soil has one or more features that are unfavorable for the specified use. The limitations generally cannot be overcome without major soil reclamation, special design, or expensive installation procedures. Poor performance and high maintenance can be expected.

Rating class terms indicate the extent to which the soils are limited by all the soil features that affect the specified use. (Septic Tank Absorption Field)					
SYSTEM COST & MAINTENANCE INCREASES	SOIL RATING (LIMITATIONS)	CONVENTIONAL GRAVITY FLOW SYSTEM	MODIFIED CONVENTIONAL SYSTEM GRAVITY FLOW	SPECIAL DEVICES (REQUIRING AERATION, UV LIGHT, PUMPS.	SPECIAL DEVICES (INCLUDING AERATION, UV LIGHT, PUMPS, MOUNDS, SPRAY/DRIP, NPDES ETC...)
	VERY LIMITED (WATER TABLE(8"-14"), BEDROCK ≤ 44"), HIGHLY PERMEABLE (SAND), SLOPE ≥ 20%, OTHER RESTRICTIONS ≤ 34", EARTH FILL, CLAY CONTENT, COMPACTED, LIMITED AREA, OTHER)	N/A	N/A	YES (TRENCH DEPTH MAY REQUIRE SOME TOPSOIL COVER AND/OR AERATION-UV LIGHT OR COMBINATION)	YES
	SOMEWHAT LIMITED (WATER TABLE(14"-26"), BEDROCK ≤ 44"), HIGHLY PERMEABLE (SAND), SLOPE, OTHER RESTRICTIONS ≤ 34"	YES	YES (TRENCH DEPTH MAY REQUIRE SOME TOPSOIL COVER, POTENTIAL DISCHARGE ON SLOPES)	YES (TRENCH DEPTH MAY REQUIRE SOME TOPSOIL COVER AND/OR AERATION-UV LIGHT OR COMBINATION- DISCHARGE POTENTIAL ON SLOPES)	N/A
	NOT LIMITED (NO RESTRICTIONS OR WATER TABLE)	YES	N/A	N/A	N/A
SYSTEM COST & MAINTENANCE INCREASES					

The Perry County Health Department has regulatory authority over residential onsite wastewater treatment systems and will make the final determination for approval or disapproval in accordance with current rules.

### LIMITATIONS

The analysis and any loading rate recommendations contained in this report are based on the data obtained from limited observation and testing of the materials encountered and our review of data provided by others and published information. Test borings indicate soil conditions only at specific locations and times, and only at the depths penetrated. They do not necessarily reflect strata or variations that may exist between exploration locations. There is no express or implied agreement that uniformity of material exists between explored locations. This information has been obtained solely for the owner's use as an aid for project design. This information is not intended for the contractor's bid development and the contractor shall not rely on the information for bidding purposes. The owner assumes no liability for the contractor's interpretation of the information contained in this report. This report has solely been provided to the contractor for informational purposes only.

This report includes all supporting exploration logs, field data, field notes, laboratory test data, calculations, estimates, and other documents prepared by Roxsol, LLC in connection with this project have been prepared for the exclusive use of Donovan Kuhn-CountryTyme Realty to our proposal dated May 21, 2025, and in accordance with generally accepted sampling practice. All terms and conditions set forth in the Agreement are incorporated herein by reference. No warranty, express or implied, is made herein. The use and reproduction of this report by any other person without the expressed written permission of Roxsol, LLC and Donovan Kuhn-CountryTyme Realty are unauthorized and such use is at the sole risk of the user.

The analyses and any loading rate recommendations must be considered preliminary until the subsurface conditions can be verified by direct observation at the time of construction. If variations in subsurface conditions from those described in this report are noted during construction, recommendations in this report may need to be re-evaluated. If any changes in the nature, design, or location of the facilities are planned, the conclusions and recommendations contained in this report should not be considered valid unless the changes are reviewed, and the conclusions of this report are verified in writing. Roxsol, LLC. is not responsible for any claims, damages, or liability associated with interpretation of subsurface data or reuse of the subsurface data or engineering analyses without the expressed written authorization of Roxsol, LLC.

This report and the attached logs are instruments of service. The subject matter of this report is limited to the facts and matters stated herein. Absence of a reference to any other conditions or subject matter shall not be construed by the reader to imply approval by the writer.


Sincerely,

A handwritten signature in blue ink, appearing to read 'Kyle Baldwin', with a stylized flourish at the end.

**Kyle Baldwin, Geologist**

**Att:** Site plan, Soil test hole logs



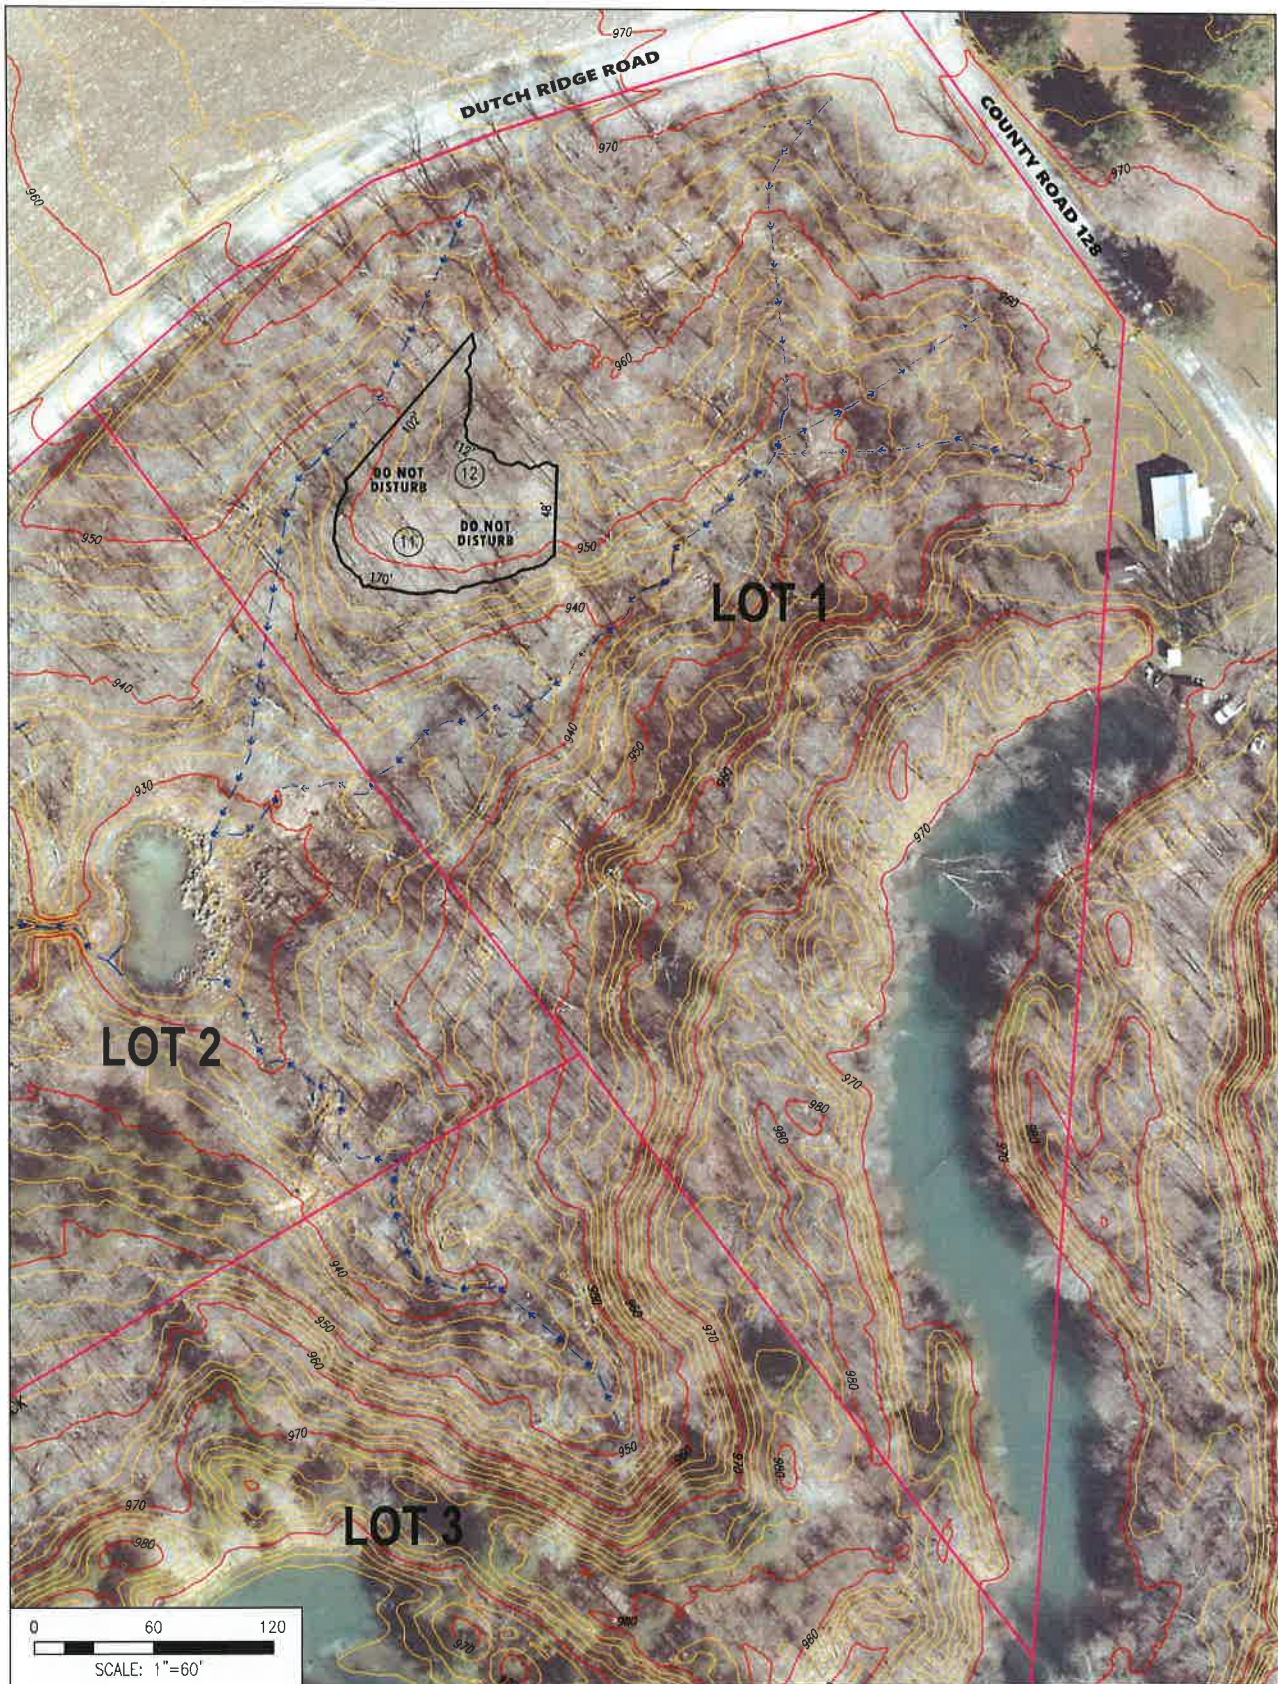

NOTE: SITE PLAN PREPARED USING GARMIN GPS, PERRY CO., AND OGRIP GIS DATA. DATA SHOWN IS ASSUMED CORRECT, BUT HAS NOT BEEN SURVEYED. HOUSE, WELL, BURIED UTILITIES AND DRIVEWAY LOCATIONS, IF SHOWN, ARE NOT FINAL. ALL SHOULD BE SITUATED ON THE LOT TO ALLOW FOR AN ON LOT SYSTEM THAT MEETS, OR EXCEEDS, THE MINIMUM SIZE REQUIRED.





# Site and Soil Evaluation for Sewage Treatment and Dispersal

County: PERRY  
 Township / Sec.: PIKE  
 Property Address/Location: 0 DUTCH RIDGE RD.  
JUNCTION CITY, OH. 43748  
 Applicant Name: COUNTRYTIME REALTY-DONOVAN KUHN  
 Address: 3451 CINCINNATI-ZANESVILLE RD. SW.  
LANCASTER, OH. 43130  
 Phone #: (614) 354-5317  
 Lot #: 240007220000  
 Test Hole #: 11  
 Latitude/Longitude: 39.68234, -82.23813  
 Method: Pit ☐ Auger ☒ Probe ☐

Land Use / Vegetation: UNDEVELOPED WOODS/BRUSH  
 Landform: UPLAND  
 Position on Landform: HILLSLOPE  
 Percent Slope: 10%  
 Shape of Slope: LINEAR-CONVEX  
 Date: May 21, 2025  
 Evaluator: KYLE BALDWIN, GEOLOGIST  
 Signature: KYLE BALDWIN  
 Phone#: 740-704-1879

AOP SOILS PROFESSIONAL  
 ODH APPROVED SOIL EVALUATOR

Soil Profile		Estimating Soil Saturation				Estimating Soil Permeability				Loading Rates																																		
Horizon	Depth (inches)	Munsell Color (hue, value, chroma)		Redoximorphic Features		Texture		Structure		Consistence	Infiltration		Linear g/dft																															
		Matrix Color		Concentrations	Depletions	Class	Approx. % Clay	Approx. % Fragments	Grade		Size	Type (shape)		>30BOD	<30BOD																													
A	6	10YR	4/3			SIL	20	0	2	M	GR	FR	0.6	0.8	TBD																													
Bt1	26	10YR	5/4			SIL	20	0	2	F	SBK	FR	0.6	0.8	TBD																													
2Bt2	38	10YR	5/4	10YR 3/2 5/6	10YR 6/2	CL	30	10	2	M	SBK	FI	0.4	0.6	TBD																													
2BC	48	10YR	5/4	10YR 3/2 5/6	10YR 6/1	CNCL	30	20	2	CO	SBK	FI	0.4	0.6	TBD																													
2C	54	10YR	5/4	10YR 3/2 5/6	10YR 6/1	CNCL	30	20	0	0	0	FI	0.0	0.0	TBD																													
	TOOL REFUSAL																																											
<table border="1"> <thead> <tr> <th colspan="2">Limiting Conditions</th> <th>Depth to (in.)</th> <th>Descriptive Notes</th> <th>Remarks / Risk Factors/ Soil Rating:</th> </tr> </thead> <tbody> <tr> <td>Perched Seasonal Water Table</td> <td></td> <td>26</td> <td>REDOXIMORPHIC FEATURES PRESENT</td> <td></td> </tr> <tr> <td>Apparent Water Table</td> <td></td> <td>N/O</td> <td>NOT OBSERVED</td> <td></td> </tr> <tr> <td>Highly Permeable Material</td> <td></td> <td>N/O</td> <td>NOT OBSERVED</td> <td>SOIL RATING: SOMEWHAT LIMITED</td> </tr> <tr> <td>Bedrock</td> <td></td> <td>N/O</td> <td>NOT OBSERVED</td> <td></td> </tr> <tr> <td>Restrictive Layer</td> <td></td> <td>48</td> <td>STRUCTURELESS</td> <td></td> </tr> </tbody> </table>															Limiting Conditions		Depth to (in.)	Descriptive Notes	Remarks / Risk Factors/ Soil Rating:	Perched Seasonal Water Table		26	REDOXIMORPHIC FEATURES PRESENT		Apparent Water Table		N/O	NOT OBSERVED		Highly Permeable Material		N/O	NOT OBSERVED	SOIL RATING: SOMEWHAT LIMITED	Bedrock		N/O	NOT OBSERVED		Restrictive Layer		48	STRUCTURELESS	
Limiting Conditions		Depth to (in.)	Descriptive Notes	Remarks / Risk Factors/ Soil Rating:																																								
Perched Seasonal Water Table		26	REDOXIMORPHIC FEATURES PRESENT																																									
Apparent Water Table		N/O	NOT OBSERVED																																									
Highly Permeable Material		N/O	NOT OBSERVED	SOIL RATING: SOMEWHAT LIMITED																																								
Bedrock		N/O	NOT OBSERVED																																									
Restrictive Layer		48	STRUCTURELESS																																									

Note : The evaluation should include a complete site plan or site drawing.

# Site and Soil Evaluation for Sewage Treatment and Dispersal

County: PERRY  
 Township / Sec.: PIKE  
 Property Address/Location: 0 DUTCH RIDGE RD.  
JUNCTION CITY, OH. 43748  
 Applicant Name: COUNTRYTyme REALTY-DONOVAN KUHN  
 Address: 3451 CINCINNATI-ZANESVILLE RD. SW.  
LANCASTER, OH. 43130  
 Phone #: (614) 354-5317  
 Lot #: 240007220000  
 Test Hole #: 12  
 Latitude/Longitude: 39.68244, -82.23802  
 Method: Pit Auger X Probe

Land Use / Vegetation: UNDEVELOPED WOODS/BRUSH  
 Landform: UPLAND  
 Position on Landform: HILLSLOPE  
 Percent Slope: 10%  
 Shape of Slope: LINEAR-CONVEX  
 Date: May 21, 2025  
 Evaluator: KYLE BALDWIN, GEOLOGIST  
 Signature: KYLE BALDWIN  
 Phone#: 740-704-1879

**AOP SOILS PROFESSIONAL**  
**ODH APPROVED SOIL EVALUATOR**

Certification #

Signature: KYLE BALDWIN

Phone#: 740-704-1879

Soil Profile		Estimating Soil Saturation				Estimating Soil Permeability				Loading Rates				
		Munsell Color (hue, value, chroma)		Redoximorphic Features		Texture		Structure		Infiltration		Linear		
Horizon	Depth (inches)	Matrix Color	Concentrations	Depletions	Class	Approx. % Clay	Approx. % Fragments	Grade	Size	Type (shape)	Consistence	>30BOD	<30BOD	g/d/ft
A	6	10YR 4/3			SIL	20	0	2	M	GR	FR	0.6	0.8	TBD
Bt1	26	10YR 5/4			SIL	20	0	2	F	SBK	FR	0.6	0.8	TBD
2Bt2	38	10YR 5/4	10YR 3/2 5/6	10YR 6/2	CL	30	10	2	M	SBK	FI	0.4	0.6	TBD
2BC	48	10YR 5/4	10YR 3/2 5/6	10YR 6/1	CNCL	30	20	2	CO	SBK	FI	0.4	0.6	TBD
2C	54	10YR 5/4	10YR 3/2 5/6	10YR 6/1	CNCL	30	20	0	0	0	FI	0.0	0.0	TBD
	TOOL REFUSAL													
Limiting Conditions		Depth to (in.)		Descriptive Notes		Remarks / Risk Factors/ Soil Rating:								
Perched Seasonal Water Table		26		REDOXIMORPHIC FEATURES PRESENT										
Apparent Water Table		N/O		NOT OBSERVED										
Highly Permeable Material		N/O		NOT OBSERVED		SOIL RATING: SOMEWHAT LIMITED								
Bedrock		N/O		NOT OBSERVED										
Restrictive Layer		48		STRUCTURELESS										

Note : The evaluation should include a complete site plan or site drawing.